

Project report: System ssący - serwerowania B S.2



System provider:

Company:
Address:
Town:
Phone:

Customer:

Szczeciński Park Naukowo – Technologiczny Sp. z o.o.
ul. Niemierzyńska 17a
71-441 Szczecin

Comment:


Budowa i wyposażenie I etapu POMERANIA TECHNOPARK w Szczecinie przy ul. Niemierzyńskiej

EN 54-20 class	EN 54-20 compliant	possible reasons
C	Yes	
B	Yes	
A	Yes	

Project name:	System ssący - serwerowania B S.2
Project build date:	2013-09-06 14:51:50
Fan level:	III
Ambient temperature [°C]	20
Ambient pressure [hPa]	950

	Tube network I	Tube network II
Maximum smoke sensor sensitivity according EN 54-20 class C	0.554	0.554
Maximum smoke sensor sensitivity according EN 54-20 class B	0.096	0.096
Maximum smoke sensor sensitivity according EN 54-20 class A	0.033	0.033
Maximum transport time [s]	18	19
Overall sampling tube length [m]	20.25	20.95
Number of sampling points	12	12

Sketch of tube network:

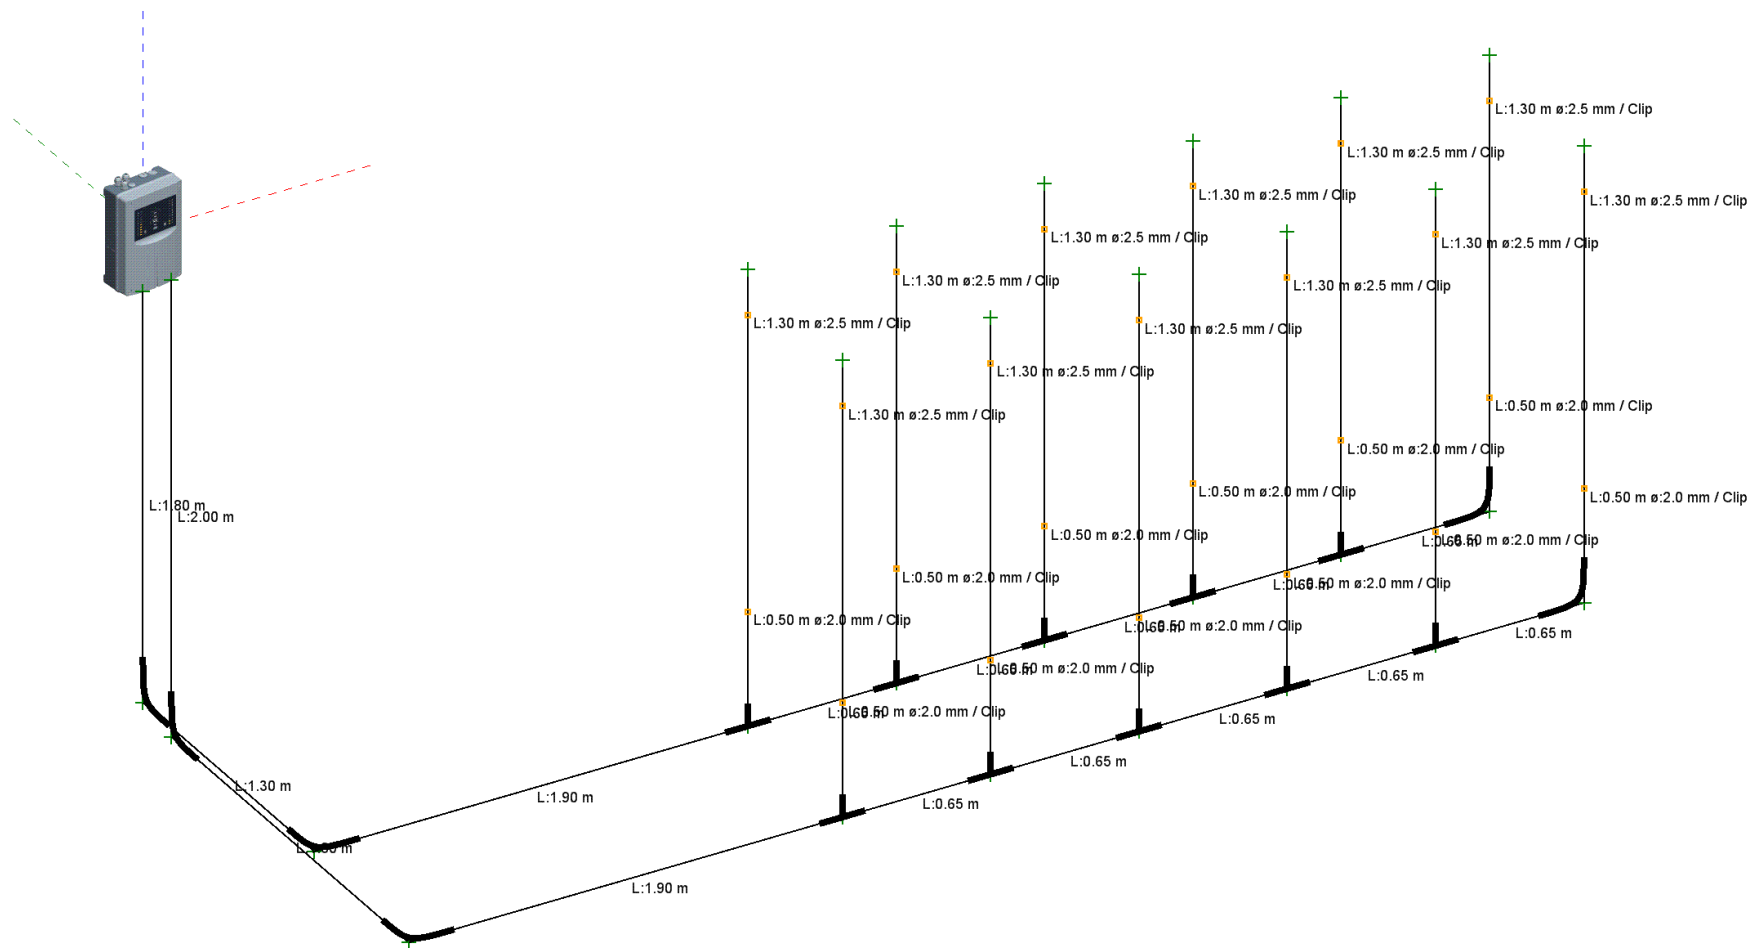

s:\Dokumenty\Odbiorcy\SPNT\DOKUMENTACJA AKTUALNA\SPNT SSAÇY\Serwerownia_B_S2.report.gif

Part	Description	RL	TL	S[C]	S[B]	S[A]	P	FI	ø	t	L-cap	Comment:
	(ASD) ASD 535		0.00					1.42		0		
A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	1.80	1.80				207	0.71		0		
A2	(BE 25 PVC) Bend 90° D=25 mm PVC		1.80									
A3	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	1.30	3.10									
A4	(BE 25 PVC) Bend 90° D=25 mm PVC		3.10									
A5	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	1.90	5.00									
A6	(TP 25 PVC) T-piece D=25 mm PVC		5.00									
A6.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	5.65									
A6.A2	(TP 25 PVC) T-piece D=25 mm PVC		5.65									
A6.A2.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	6.30									
A6.A2.A2	(TP 25 PVC) T-piece D=25 mm PVC		6.30									
A6.A2.A2.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	6.95									
A6.A2.A2.A2	(TP 25 PVC) T-piece D=25 mm PVC		6.95									
A6.A2.A2.A2.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	7.60									
A6.A2.A2.A2.A2	(TP 25 PVC) T-piece D=25 mm PVC		7.60									
A6.A2.A2.A2.A2.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	8.25									
A6.A2.A2.A2.A2.A2	(BE 25 PVC) Bend 90° D=25 mm PVC		8.25									
A6.A2.A2.A2.A2.A3	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	10.25									
A6.A2.A2.A2.A2.A3 - 1	-1- Sampling point / clip	0.50	8.75	6.670	1.160	0.400	189	0.06	2.00	10		
A6.A2.A2.A2.A2.A3 - 2	-2- Sampling point / clip	1.30	10.05	6.670	1.160	0.400	189	0.06	2.50	18		
A6.A2.A2.A2.A2.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	9.60									
A6.A2.A2.A2.A2.B1 - 1	-1- Sampling point / clip	0.50	8.10	6.670	1.160	0.400	189	0.06	2.00	8		
A6.A2.A2.A2.A2.B1 - 2	-2- Sampling point / clip	1.30	9.40	6.670	1.160	0.400	189	0.06	2.50	15		
A6.A2.A2.A2.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	8.95									
A6.A2.A2.A2.B1 - 1	-1- Sampling point / clip	0.50	7.45	6.660	1.160	0.400	190	0.06	2.00	6		
A6.A2.A2.A2.B1 - 2	-2- Sampling point / clip	1.30	8.75	6.670	1.160	0.400	189	0.06	2.50	14		
A6.A2.A2.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	8.30									
A6.A2.A2.B1 - 1	-1- Sampling point / clip	0.50	6.80	6.650	1.160	0.390	190	0.06	2.00	6		
A6.A2.A2.B1 - 2	-2- Sampling point / clip	1.30	8.10	6.660	1.160	0.390	190	0.06	2.50	13		
A6.A2.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	7.65									
A6.A2.B1 - 1	-1- Sampling point / clip	0.50	6.15	6.640	1.160	0.390	191	0.06	2.00	5		
A6.A2.B1 - 2	-2- Sampling point / clip	1.30	7.45	6.640	1.160	0.390	191	0.06	2.50	13		
A6.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	7.00									
A6.B1 - 1	-1- Sampling point / clip	0.50	5.50	6.620	1.150	0.390	192	0.06	2.00	5		
A6.B1 - 2	-2- Sampling point / clip	1.30	6.80	6.620	1.150	0.390	192	0.06	2.50	12		
B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	2.00				207	0.71		0		
B2	(BE 25 PVC) Bend 90° D=25 mm PVC		2.00									
B3	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	1.80	3.80									
B4	(BE 25 PVC) Bend 90° D=25 mm PVC		3.80									
B5	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	1.90	5.70									
B6	(TP 25 PVC) T-piece D=25 mm PVC		5.70									

Part	Description	RL	TL	S[C]	S[B]	S[A]	P	FI	ø	t	L-cap	Comment:
B6.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	6.35									
B6.A2	(TP 25 PVC) T-piece D=25 mm PVC		6.35									
B6.A2.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	7.00									
B6.A2.A2	(TP 25 PVC) T-piece D=25 mm PVC		7.00									
B6.A2.A2.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	7.65									
B6.A2.A2.A2	(TP 25 PVC) T-piece D=25 mm PVC		7.65									
B6.A2.A2.A2.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	8.30									
B6.A2.A2.A2.A2	(TP 25 PVC) T-piece D=25 mm PVC		8.30									
B6.A2.A2.A2.A2.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	8.95									
B6.A2.A2.A2.A2.A2	(BE 25 PVC) Bend 90° D=25 mm PVC		8.95									
B6.A2.A2.A2.A2.A3	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	10.95									
B6.A2.A2.A2.A2.A3 - 1	-1- Sampling point / clip	0.50	9.45	6.670	1.160	0.400	187	0.06	2.00	11		
B6.A2.A2.A2.A2.A3 - 2	-2- Sampling point / clip	1.30	10.75	6.670	1.160	0.400	187	0.06	2.50	19		
B6.A2.A2.A2.A2.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	10.30									
B6.A2.A2.A2.A2.B1 - 1	-1- Sampling point / clip	0.50	8.80	6.670	1.160	0.400	188	0.06	2.00	8		
B6.A2.A2.A2.A2.B1 - 2	-2- Sampling point / clip	1.30	10.10	6.670	1.160	0.400	187	0.06	2.50	16		
B6.A2.A2.A2.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	9.65									
B6.A2.A2.A2.B1 - 1	-1- Sampling point / clip	0.50	8.15	6.660	1.160	0.400	188	0.06	2.00	7		
B6.A2.A2.A2.B1 - 2	-2- Sampling point / clip	1.30	9.45	6.670	1.160	0.400	188	0.06	2.50	15		
B6.A2.A2.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	9.00									
B6.A2.A2.B1 - 1	-1- Sampling point / clip	0.50	7.50	6.650	1.160	0.390	188	0.06	2.00	6		
B6.A2.A2.B1 - 2	-2- Sampling point / clip	1.30	8.80	6.660	1.160	0.390	188	0.06	2.50	14		
B6.A2.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	8.35									
B6.A2.B1 - 1	-1- Sampling point / clip	0.50	6.85	6.640	1.160	0.390	189	0.06	2.00	6		
B6.A2.B1 - 2	-2- Sampling point / clip	1.30	8.15	6.640	1.160	0.390	189	0.06	2.50	14		
B6.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	7.70									
B6.B1 - 1	-1- Sampling point / clip	0.50	6.20	6.620	1.150	0.390	190	0.06	2.00	5		
B6.B1 - 2	-2- Sampling point / clip	1.30	7.50	6.620	1.150	0.390	190	0.06	2.50	13		
RL: Relative length of this part (distance to previous SP or bend) [m] TL: Total length of the part end to the ASD [m] S[C]: smoke sensitivity [%/m] for this sampling hole, when the smoke sensor alarm level is chosen as proposed in this report. S[B]: smoke sensitivity [%/m] for this sampling hole, when the smoke sensor alarm level is chosen as proposed in this report. S[A]: smoke sensitivity [%/m] for this sampling hole, when the smoke sensor alarm level is chosen as proposed in this report. P: Pressure [Pa] FI: airflow [Liter/s] of this sampling point t: transport time to the ASD [s] L-cap: Length of the capillary / stub [m]												

Material list:

Part	Number	Length [m]	Rod length [m]	Number of rods	Comment:
(ASD) ASD 535	1				
(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	28	41.20			
(SO 25 PVC) Socket D=25 mm PVC	11				
(BE 25 PVC) Bend 90° D=25 mm PVC	6				
(TP 25 PVC) T-piece D=25 mm PVC	10				
(EC 25 PVC) End cap D=25 mm PVC	12				
(CLIP 2.0 PA) Sampling hole clip d=2.0 mm red PA	12				
(CLIP 2.5 PA) Sampling hole clip d=2.5 mm red PA	12				
(PC 25 PP) Pipe clamp type Goema halogen-free	42				