

Project report: System ssący - serwerownia D S.6



System provider:

Company:
Address:
Town:
Phone:

Customer:

Szczeciński Park Naukowo – Technologiczny Sp. z o.o
ul. Niemierzyńska 17a
71-441 Szczecin

Comment:


Budowa i wyposażenie I etapu POMERANIA TECHNOPARK w Szczecinie przy ul. Niemierzyńskiej

EN 54-20 class	EN 54-20 compliant	possible reasons
C	Yes	
B	Yes	
A	Yes	

Project name:	System ssący - serwerownia D S.6
Project build date:	2013-09-06 15:00:02
Fan level:	III
Ambient temperature [°C]	20
Ambient pressure [hPa]	950

	Tube network I	Tube network II
Maximum smoke sensor sensitivity according EN 54-20 class C	0.554	0.554
Maximum smoke sensor sensitivity according EN 54-20 class B	0.096	0.096
Maximum smoke sensor sensitivity according EN 54-20 class A	0.033	0.033
Maximum transport time [s]	18	20
Overall sampling tube length [m]	19.45	22.65
Number of sampling points	12	12

Sketch of tube network:

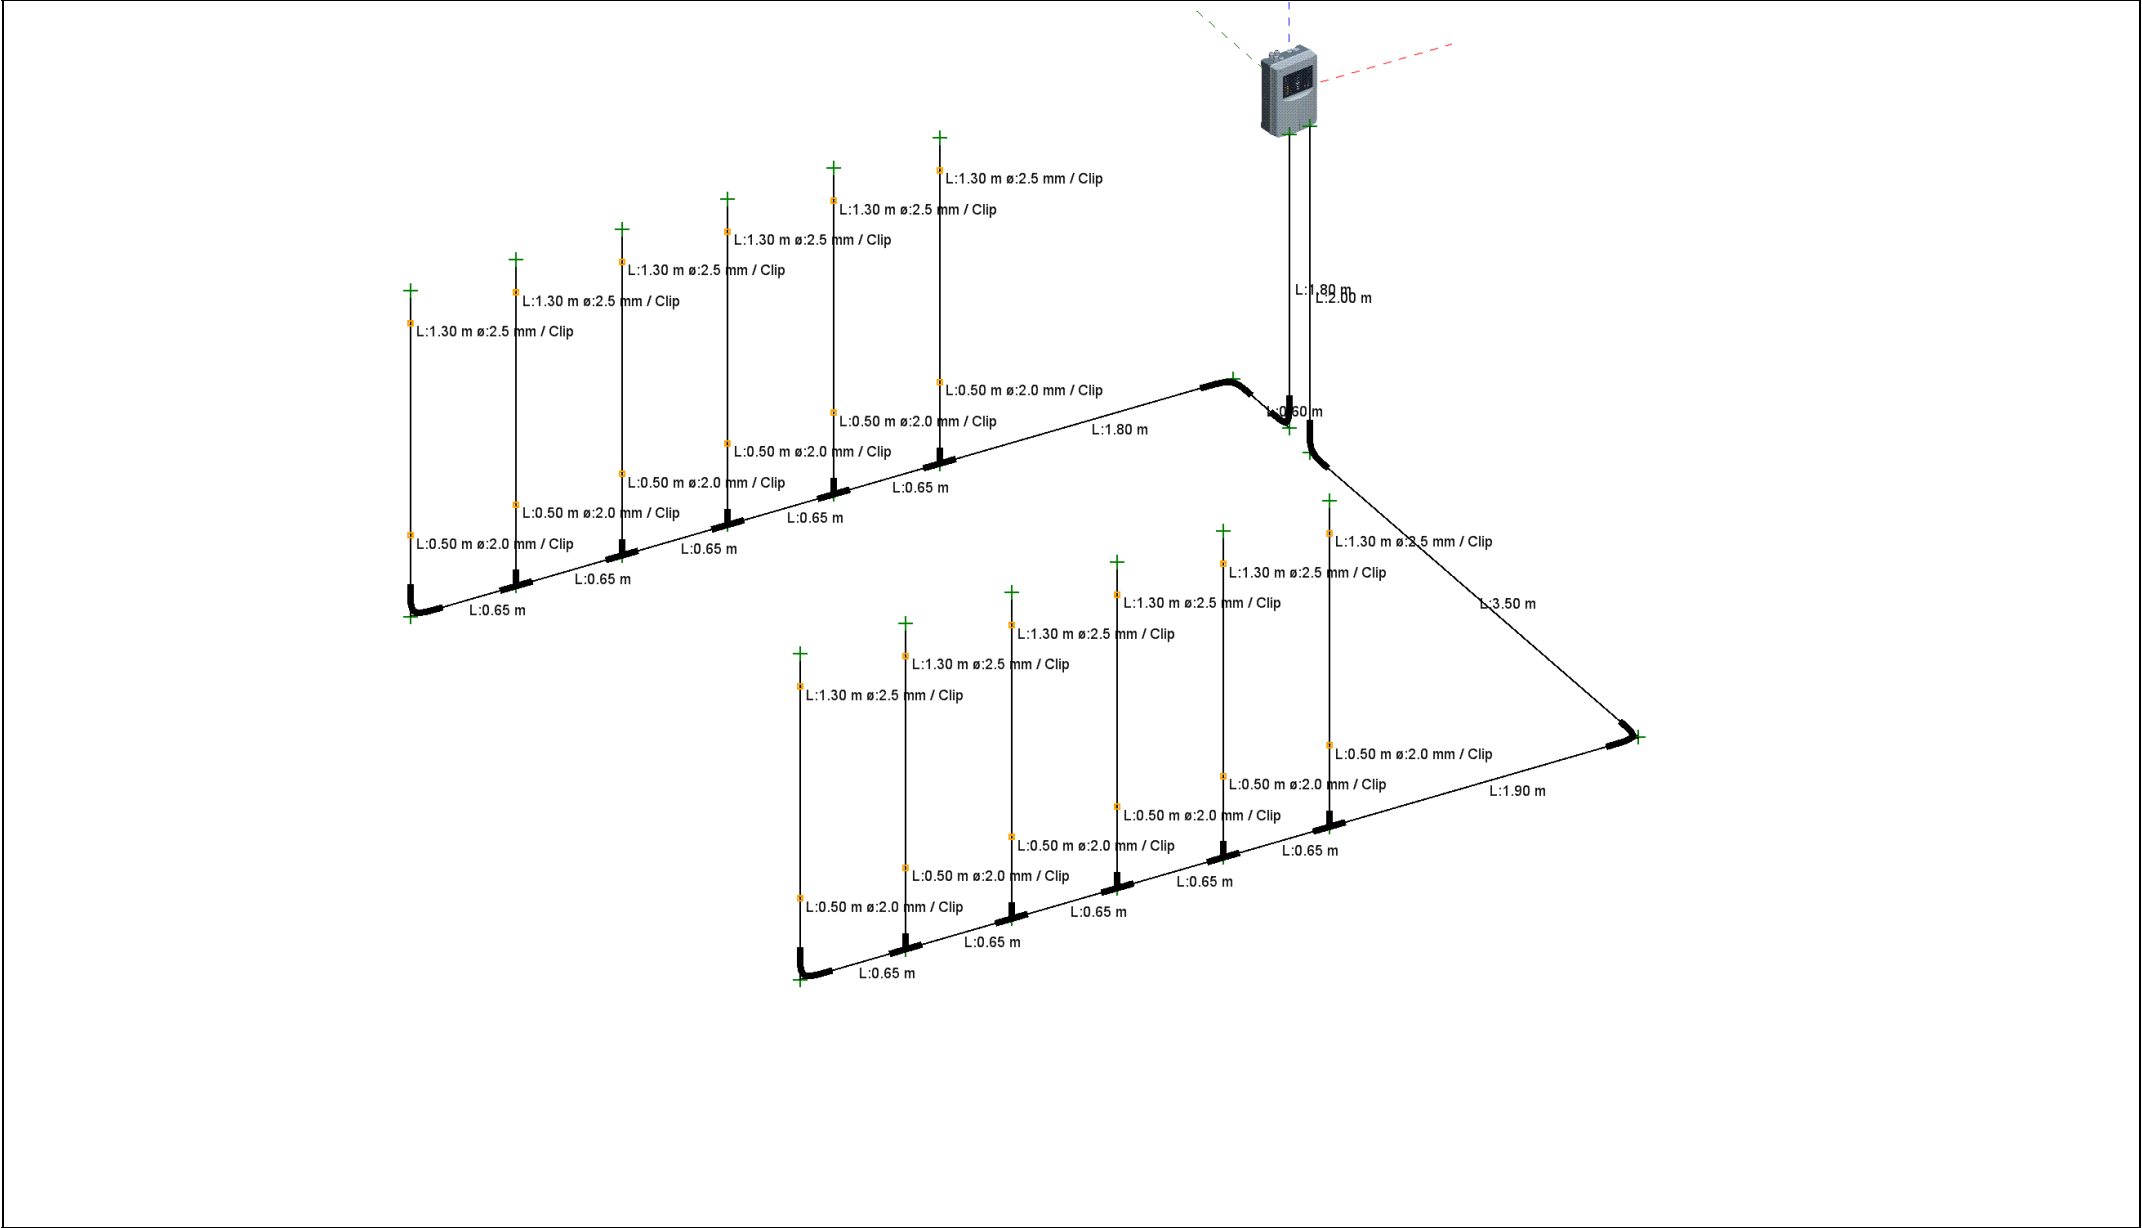

s:\Dokumenty\Odbiorcy\SPNT\DOKUMENTACJA AKTUALNA\SPNT SSAĆY\Serwerownia_D_S6.report.gif

Part	Description	RL	TL	S[C]	S[B]	S[A]	P	FI	ø	t	L-cap	Comment:
	(ASD) ASD 535		0.00					1.42		0		
A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	1.80	1.80				207	0.72		0		
A2	(BE 25 PVC) Bend 90° D=25 mm PVC		1.80									
A3	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.60	2.40									
A4	(BE 25 PVC) Bend 90° D=25 mm PVC		2.40									
A5	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	1.80	4.20									
A6	(TP 25 PVC) T-piece D=25 mm PVC		4.20									
A6.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	4.85									
A6.A2	(TP 25 PVC) T-piece D=25 mm PVC		4.85									
A6.A2.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	5.50									
A6.A2.A2	(TP 25 PVC) T-piece D=25 mm PVC		5.50									
A6.A2.A2.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	6.15									
A6.A2.A2.A2	(TP 25 PVC) T-piece D=25 mm PVC		6.15									
A6.A2.A2.A2.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	6.80									
A6.A2.A2.A2.A2	(TP 25 PVC) T-piece D=25 mm PVC		6.80									
A6.A2.A2.A2.A2.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	7.45									
A6.A2.A2.A2.A2.A2	(BE 25 PVC) Bend 90° D=25 mm PVC		7.45									
A6.A2.A2.A2.A2.A3	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	9.45									
A6.A2.A2.A2.A2.A3 - 1	-1- Sampling point / clip	0.50	7.95	6.670	1.160	0.400	191	0.06	2.00	10		
A6.A2.A2.A2.A2.A3 - 2	-2- Sampling point / clip	1.30	9.25	6.670	1.160	0.400	191	0.06	2.50	18		
A6.A2.A2.A2.A2.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	8.80									
A6.A2.A2.A2.A2.B1 - 1	-1- Sampling point / clip	0.50	7.30	6.670	1.160	0.400	192	0.06	2.00	7		
A6.A2.A2.A2.A2.B1 - 2	-2- Sampling point / clip	1.30	8.60	6.670	1.160	0.400	191	0.06	2.50	15		
A6.A2.A2.A2.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	8.15									
A6.A2.A2.A2.B1 - 1	-1- Sampling point / clip	0.50	6.65	6.660	1.160	0.400	192	0.06	2.00	6		
A6.A2.A2.A2.B1 - 2	-2- Sampling point / clip	1.30	7.95	6.670	1.160	0.400	192	0.06	2.50	14		
A6.A2.A2.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	7.50									
A6.A2.A2.B1 - 1	-1- Sampling point / clip	0.50	6.00	6.650	1.160	0.390	192	0.06	2.00	5		
A6.A2.A2.B1 - 2	-2- Sampling point / clip	1.30	7.30	6.660	1.160	0.390	192	0.06	2.50	13		
A6.A2.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	6.85									
A6.A2.B1 - 1	-1- Sampling point / clip	0.50	5.35	6.640	1.160	0.390	193	0.06	2.00	5		
A6.A2.B1 - 2	-2- Sampling point / clip	1.30	6.65	6.640	1.160	0.390	193	0.06	2.50	12		
A6.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	6.20									
A6.B1 - 1	-1- Sampling point / clip	0.50	4.70	6.620	1.150	0.390	195	0.06	2.00	4		
A6.B1 - 2	-2- Sampling point / clip	1.30	6.00	6.620	1.150	0.390	194	0.06	2.50	12		
B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	2.00				207	0.70		0		
B2	(BE 25 PVC) Bend 90° D=25 mm PVC		2.00									
B3	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	3.50	5.50									
B4	(BE 25 PVC) Bend 90° D=25 mm PVC		5.50									
B5	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	1.90	7.40									
B6	(TP 25 PVC) T-piece D=25 mm PVC		7.40									

Part	Description	RL	TL	S[C]	S[B]	S[A]	P	FI	ø	t	L-cap	Comment:
B6.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	8.05									
B6.A2	(TP 25 PVC) T-piece D=25 mm PVC		8.05									
B6.A2.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	8.70									
B6.A2.A2	(TP 25 PVC) T-piece D=25 mm PVC		8.70									
B6.A2.A2.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	9.35									
B6.A2.A2.A2	(TP 25 PVC) T-piece D=25 mm PVC		9.35									
B6.A2.A2.A2.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	10.00									
B6.A2.A2.A2.A2	(TP 25 PVC) T-piece D=25 mm PVC		10.00									
B6.A2.A2.A2.A2.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.65	10.65									
B6.A2.A2.A2.A2.A2	(BE 25 PVC) Bend 90° D=25 mm PVC		10.65									
B6.A2.A2.A2.A2.A3	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	12.65									
B6.A2.A2.A2.A2.A3 - 1	-1- Sampling point / clip	0.50	11.15	6.670	1.160	0.400	184	0.06	2.00	12		
B6.A2.A2.A2.A2.A3 - 2	-2- Sampling point / clip	1.30	12.45	6.670	1.160	0.400	183	0.06	2.50	20		
B6.A2.A2.A2.A2.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	12.00									
B6.A2.A2.A2.A2.B1 - 1	-1- Sampling point / clip	0.50	10.50	6.670	1.160	0.400	184	0.06	2.00	9		
B6.A2.A2.A2.A2.B1 - 2	-2- Sampling point / clip	1.30	11.80	6.670	1.160	0.400	183	0.06	2.50	17		
B6.A2.A2.A2.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	11.35									
B6.A2.A2.A2.B1 - 1	-1- Sampling point / clip	0.50	9.85	6.660	1.160	0.400	184	0.06	2.00	8		
B6.A2.A2.A2.B1 - 2	-2- Sampling point / clip	1.30	11.15	6.670	1.160	0.400	184	0.06	2.50	16		
B6.A2.A2.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	10.70									
B6.A2.A2.B1 - 1	-1- Sampling point / clip	0.50	9.20	6.650	1.160	0.390	184	0.06	2.00	7		
B6.A2.A2.B1 - 2	-2- Sampling point / clip	1.30	10.50	6.660	1.160	0.390	184	0.06	2.50	15		
B6.A2.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	10.05									
B6.A2.B1 - 1	-1- Sampling point / clip	0.50	8.55	6.640	1.160	0.390	185	0.06	2.00	7		
B6.A2.B1 - 2	-2- Sampling point / clip	1.30	9.85	6.640	1.160	0.390	185	0.06	2.50	14		
B6.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	9.40									
B6.B1 - 1	-1- Sampling point / clip	0.50	7.90	6.620	1.150	0.390	186	0.06	2.00	6		
B6.B1 - 2	-2- Sampling point / clip	1.30	9.20	6.620	1.150	0.390	186	0.06	2.50	14		
RL: Relative length of this part (distance to previous SP or bend) [m] TL: Total length of the part end to the ASD [m] S[C]: smoke sensitivity [%/m] for this sampling hole, when the smoke sensor alarm level is chosen as proposed in this report. S[B]: smoke sensitivity [%/m] for this sampling hole, when the smoke sensor alarm level is chosen as proposed in this report. S[A]: smoke sensitivity [%/m] for this sampling hole, when the smoke sensor alarm level is chosen as proposed in this report. P: Pressure [Pa] FI: airflow [Liter/s] of this sampling point t: transport time to the ASD [s] L-cap: Length of the capillary / stub [m]												

Material list:

Part	Number	Length [m]	Rod length [m]	Number of rods	Comment:
(ASD) ASD 535	1				
(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	28	42.10			
(SO 25 PVC) Socket D=25 mm PVC	11				
(BE 25 PVC) Bend 90° D=25 mm PVC	6				
(TP 25 PVC) T-piece D=25 mm PVC	10				
(EC 25 PVC) End cap D=25 mm PVC	12				
(CLIP 2.0 PA) Sampling hole clip d=2.0 mm red PA	12				
(CLIP 2.5 PA) Sampling hole clip d=2.5 mm red PA	12				
(PC 25 PP) Pipe clamp type Goema halogen-free	43				