

Project report: System ssący - serwerownia B GPD



System provider:

Company:
Address:
Town:
Phone:

Customer:

Szczeciński Park Naukowo – Technologiczny Sp. z o.o.
ul. Niemierzyńska 17a
71-441 Szczecin

Comment:


Budowa i wyposażenie I etapu POMERANIA TECHNOPARK w Szczecinie przy ul. Niemierzyńskiej

EN 54-20 class	EN 54-20 compliant	possible reasons
C	Yes	
B	Yes	
A	Yes	

Project name:	System ssący - serwerownia B GPD
Project build date:	2013-09-06 14:50:00
Fan level:	III
Ambient temperature [°C]	20
Ambient pressure [hPa]	950

	Tube network I	Tube network II
Maximum smoke sensor sensitivity according EN 54-20 class C	1.668	--
Maximum smoke sensor sensitivity according EN 54-20 class B	0.290	--
Maximum smoke sensor sensitivity according EN 54-20 class A	0.099	--
Maximum transport time [s]	20	--
Overall sampling tube length [m]	11.75	--
Number of sampling points	4	--

Sketch of tube network:

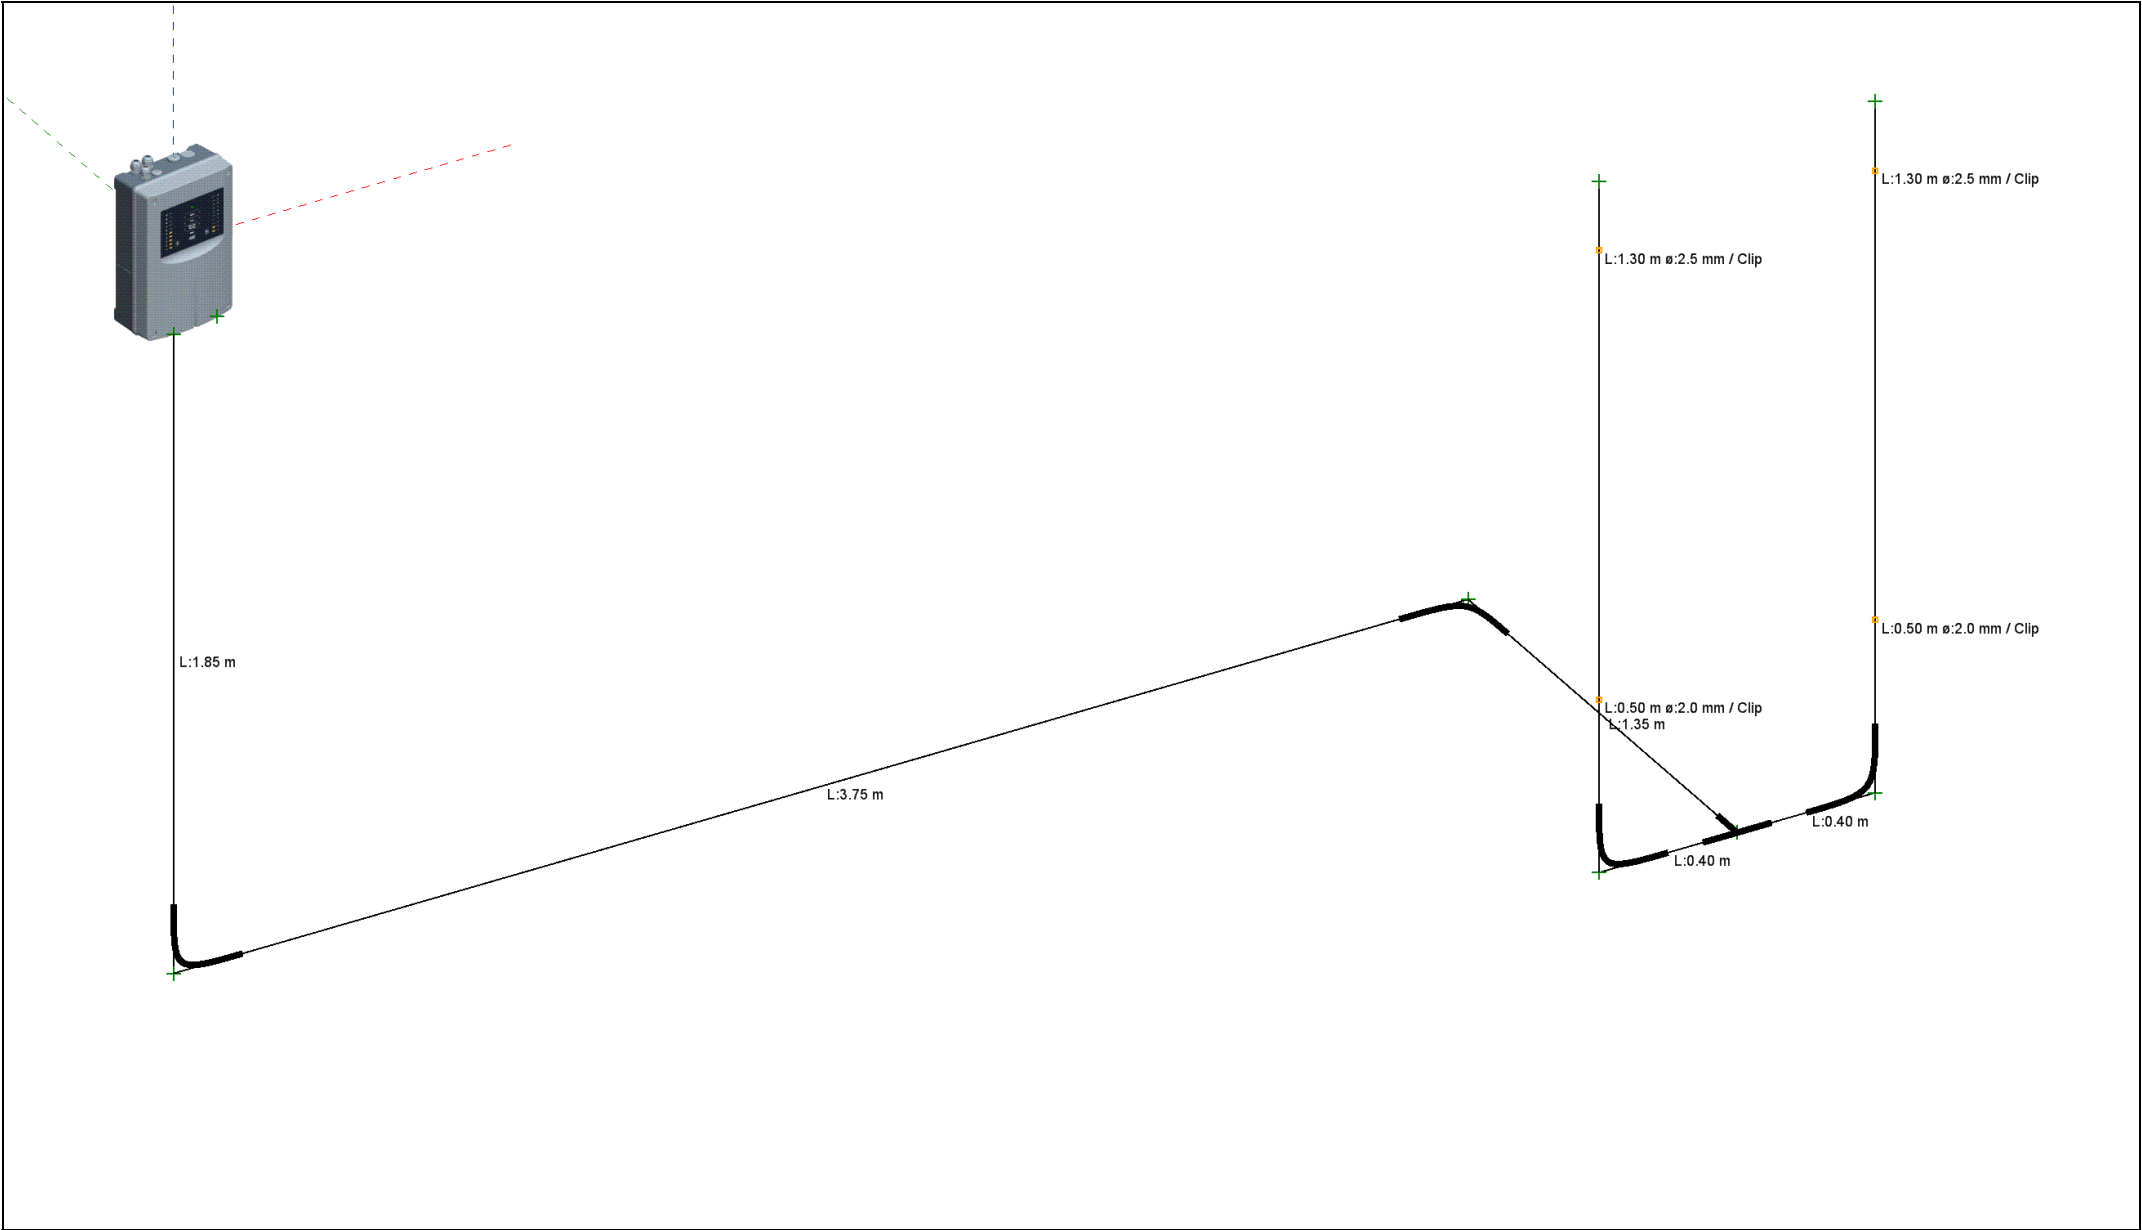

s:\Dokumenty\Odbiorcy\SPNT\DOKUMENTACJA AKTUALNA\SPNT SSAÇY\Serwerownia_B_GPD.report.gif



Part	Description	RL	TL	S[C]	S[B]	S[A]	P	FI	ø	t	L-cap	Comment:
	(ASD) ASD 535		0.00					0.27		0		
A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	1.85	1.85				256	0.27		0		
A2	(BE 25 PVC) Bend 90° D=25 mm PVC		1.85									
A3	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	3.75	5.60									
A4	(BE 25 PVC) Bend 90° D=25 mm PVC		5.60									
A5	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	1.35	6.95									
A6	(TP 25 PVC) T-piece D=25 mm PVC		6.95									
A6.A1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.40	7.35									
A6.A2	(BE 25 PVC) Bend 90° D=25 mm PVC		7.35									
A6.A3	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	9.35									
A6.A3 - 1	-1- Sampling point / clip	0.50	7.85	6.670	1.160	0.400	252	0.07	2.00	13		
A6.A3 - 2	-2- Sampling point / clip	1.30	9.15	6.670	1.160	0.400	252	0.07	2.50	20		
A6.B1	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	0.40	7.35									
A6.B2	(BE 25 PVC) Bend 90° D=25 mm PVC		7.35									
A6.B3	(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	2.00	9.35									
A6.B3 - 1	-1- Sampling point / clip	0.50	7.85	6.670	1.160	0.400	252	0.07	2.00	13		
A6.B3 - 2	-2- Sampling point / clip	1.30	9.15	6.670	1.160	0.400	252	0.07	2.50	20		
RL: Relative length of this part (distance to previous SP or bend) [m] TL: Total length of the part end to the ASD [m] S[C]: smoke sensitivity [%/m] for this sampling hole, when the smoke sensor alarm level is chosen as proposed in this report. S[B]: smoke sensitivity [%/m] for this sampling hole, when the smoke sensor alarm level is chosen as proposed in this report. S[A]: smoke sensitivity [%/m] for this sampling hole, when the smoke sensor alarm level is chosen as proposed in this report. P: Pressure [Pa] FI: airflow [Liter/s] of this sampling point t: transport time to the ASD [s] L-cap: Length of the capillary / stub [m]												

Material list:

Part	Number	Length [m]	Rod length [m]	Number of rods	Comment:
(ASD) ASD 535	1				
(TU 25 PVC) Sampling tube D=25 mm PVC, l=5 m	7	11.75			
(SO 25 PVC) Socket D=25 mm PVC	3				
(BE 25 PVC) Bend 90° D=25 mm PVC	4				
(TP 25 PVC) T-piece D=25 mm PVC	1				
(EC 25 PVC) End cap D=25 mm PVC	2				
(CLIP 2.0 PA) Sampling hole clip d=2.0 mm red PA	2				
(CLIP 2.5 PA) Sampling hole clip d=2.5 mm red PA	2				
(PC 25 PP) Pipe clamp type Goema halogen-free	12				